


CONSTRUCTION NOTE
NEW WET WELL CONSTRUCTION MUST USE 1800 MINIMUM INTERNAL DIAMETER RISER WHEN USING MANUKAU WATER ACCESS HATCH WITH 1300 x 810 ACCESS OPENING IN CONCRETE LID

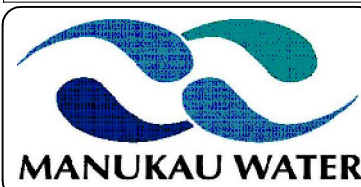

WASTEWATER PUMPING STATION STANDARDS
ACCESS HATCH LAYOUT FOR FLYGT TOP - 100 WET WELL SUMP LINER

Design and Material Standards - Manukau Water Limited

DETAIL NO:	PS-06
SCALE:	1:20 @ A3
UPDATED:	JULY 2006