


	Diameter >100	Diameter <100	50mm MDPE
Trench width minimum	OD+200	OD+100	100
Blanket thickness minimum	100	50	40
Bedding depth minimum	75	50	0 or 50*
Minimum Side fill	75	50	10 – 20

* 50mm required in rock

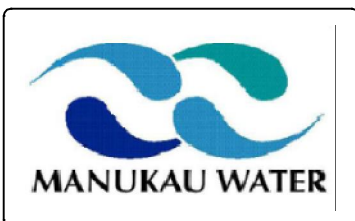

WATERMAIN PIPE BEDDING DETAIL

DETAIL NO:

DW-4

**Design and Material Standards
MANUKAU WATER LIMITED**

UPDATED:

JULY 2006